



**CONDUIT MATERIAL LIST  
FURNISHED AND INSTALLED  
BY THE CUSTOMER / ELECTRICIAN**

- (1) 10' LENGTH OF 3" EPVC PIPE, SCHEDULE 40
- (1) SWEEP ELBOW
- (1) COUPLING
- (1) MALE ADAPTER & LOCK RING

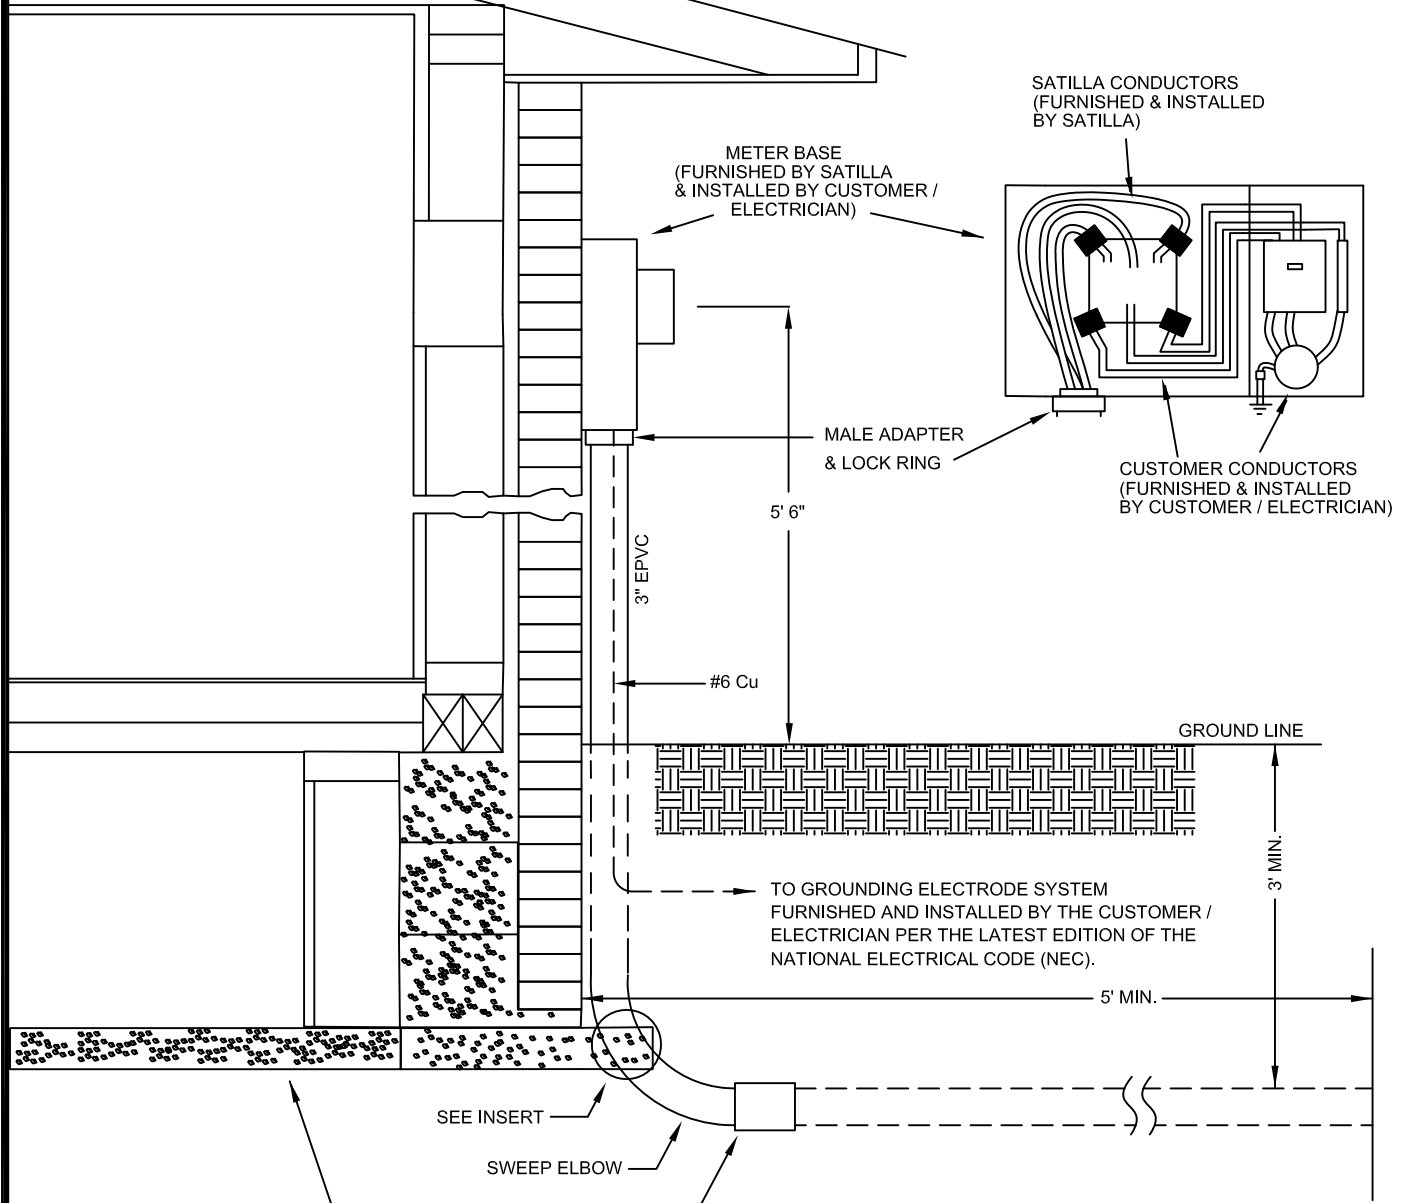

**NOTES:**

1. SOME SPECIFICATIONS ON THIS PAGE REPRESENT MINIMUM STANDARDS. LOCAL CODES MAY CALL FOR ADDITIONAL OR MORE STRINGENT REQUIREMENTS. CUSTOMER / ELECTRICIAN MUST ENSURE COMPLIANCE WITH ALL APPLICABLE CODES GOVERNING ELECTRICAL SERVICE.
2. NATIONAL ELECTRICAL SAFETY CODE (NESC) REQUIREMENTS PROHIBIT CONSUMERS FROM WORKING CLOSER THAN 12" OF ENERGIZED SATILLA REMC CONDUCTORS OR INSTALLING ANY EQUIPMENT WITHIN 12" OF SATILLA REMC OVERHEAD CONDUCTORS.
3. NATIONAL ELECTRICAL CODE (NEC) REQUIRES ALL CONDUCTORS ENTERING OR EXITING A METER BASE OR A CONSUMER'S DISCONNECT TO "BE PROTECTED AGAINST PHYSICAL DAMAGE." THEREFORE, ALL EXTERIOR CONDUCTORS SHOULD BE INSTALLED IN SUITABLE CONDUIT.

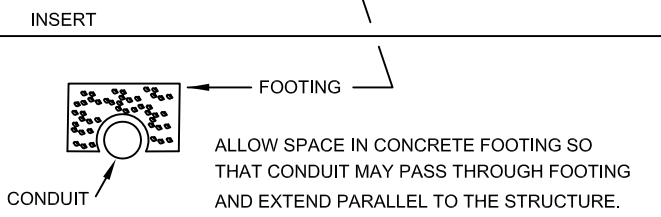

**SATILLA REMC UG WIRING DIAGRAM  
SERVICE DISCONNECT LOCATED OUTSIDE**

SATILLA REMC

date :

02/29/16

**M25-2**